

Sample Received: May 6, 2026

COA Issued: June 23, 2026

PRODUCT INFORMATION


Vendor: Echelon Peptides	Sample Name: BAC Water	Sample Type: Clear liquid	Lot Number: CD013026A	MW (g/mol): 91.0
-----------------------------	---------------------------	------------------------------	--------------------------	---------------------

ANALYTICAL METHODS

Identity: Confirmed via MALDI-MS
Purity: RP-HPLC (214 nm)
Content: HPLC quantitation

TEST RESULTS

Specification	Result	Method	Status
Identity: BAC Water	Benzyl Alcohol	MALDI-MS	✓ Conforms
Content	0.998 %	HPLC Quantitation	✓ Conforms
Overall Purity	99.9%	RP-HPLC (214 nm)	✓ Conforms
pH	6.90	pH Meter	✓ Conforms

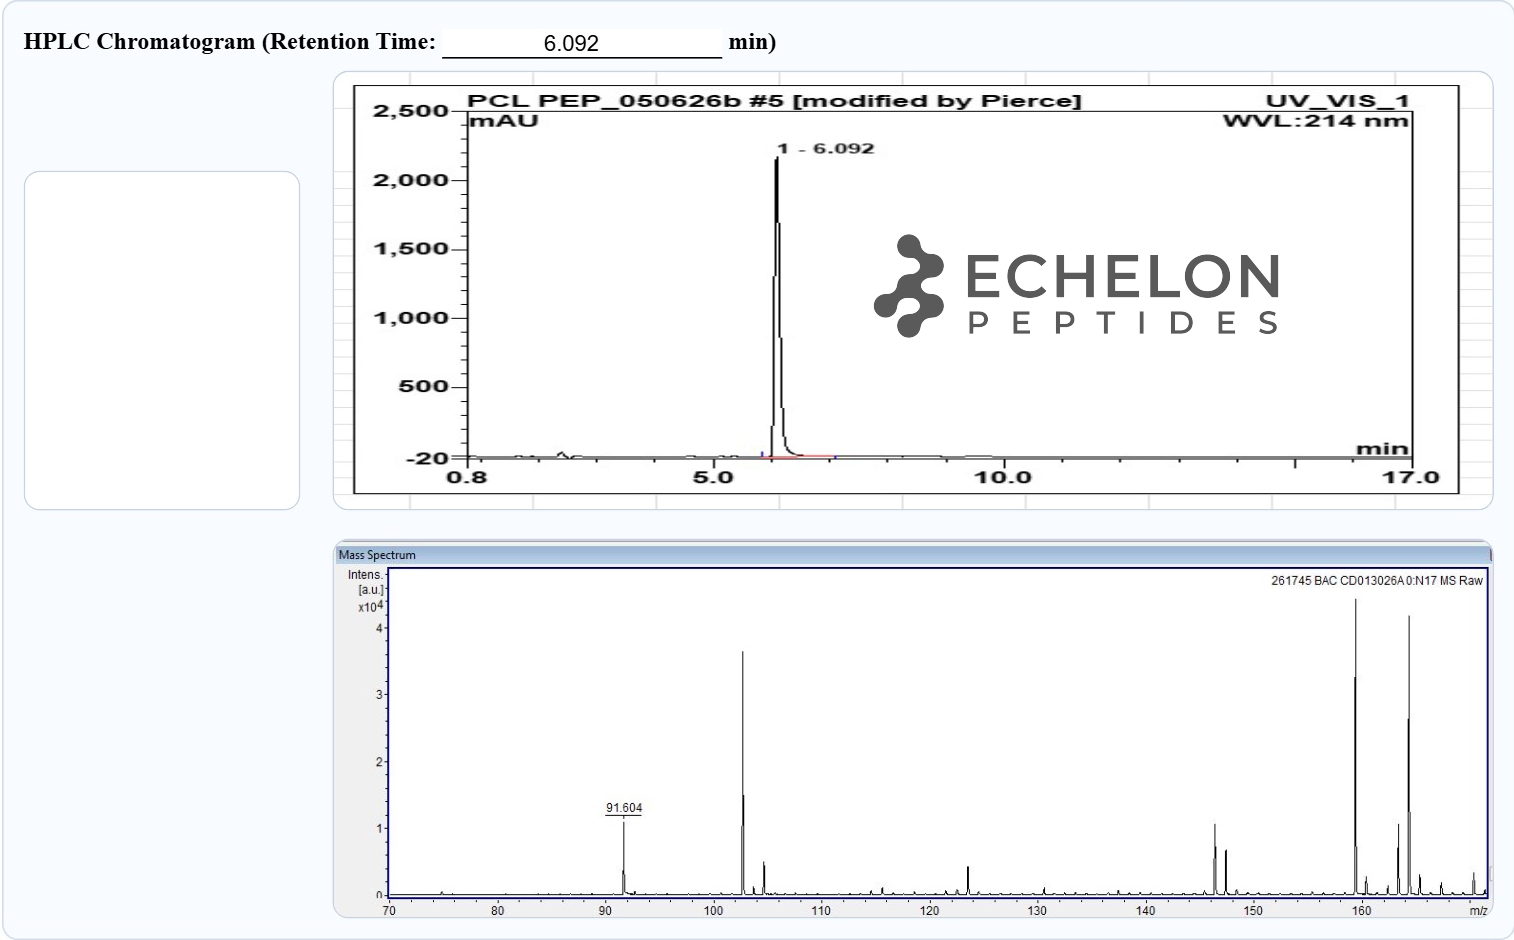

Certification: This COA confirms that the tested material meets or exceeds Bioviridian’s analytical quality specifications for peptide research use.
Visit: <https://bioviridians.com/coa-search.html>



Shane Straight, M.S.
Principal Chemist, Bioviridian Inc.